


Accessible Classroom Set-Up

Remove two chairs for each mobility device space. Offer multiple choices of where to sit. Increase the amount of accessible seating based on the known or anticipated number of mobility device users expected at your event. Note minimum widths for center and side aisles, and for the distance between accessible and standard rows.

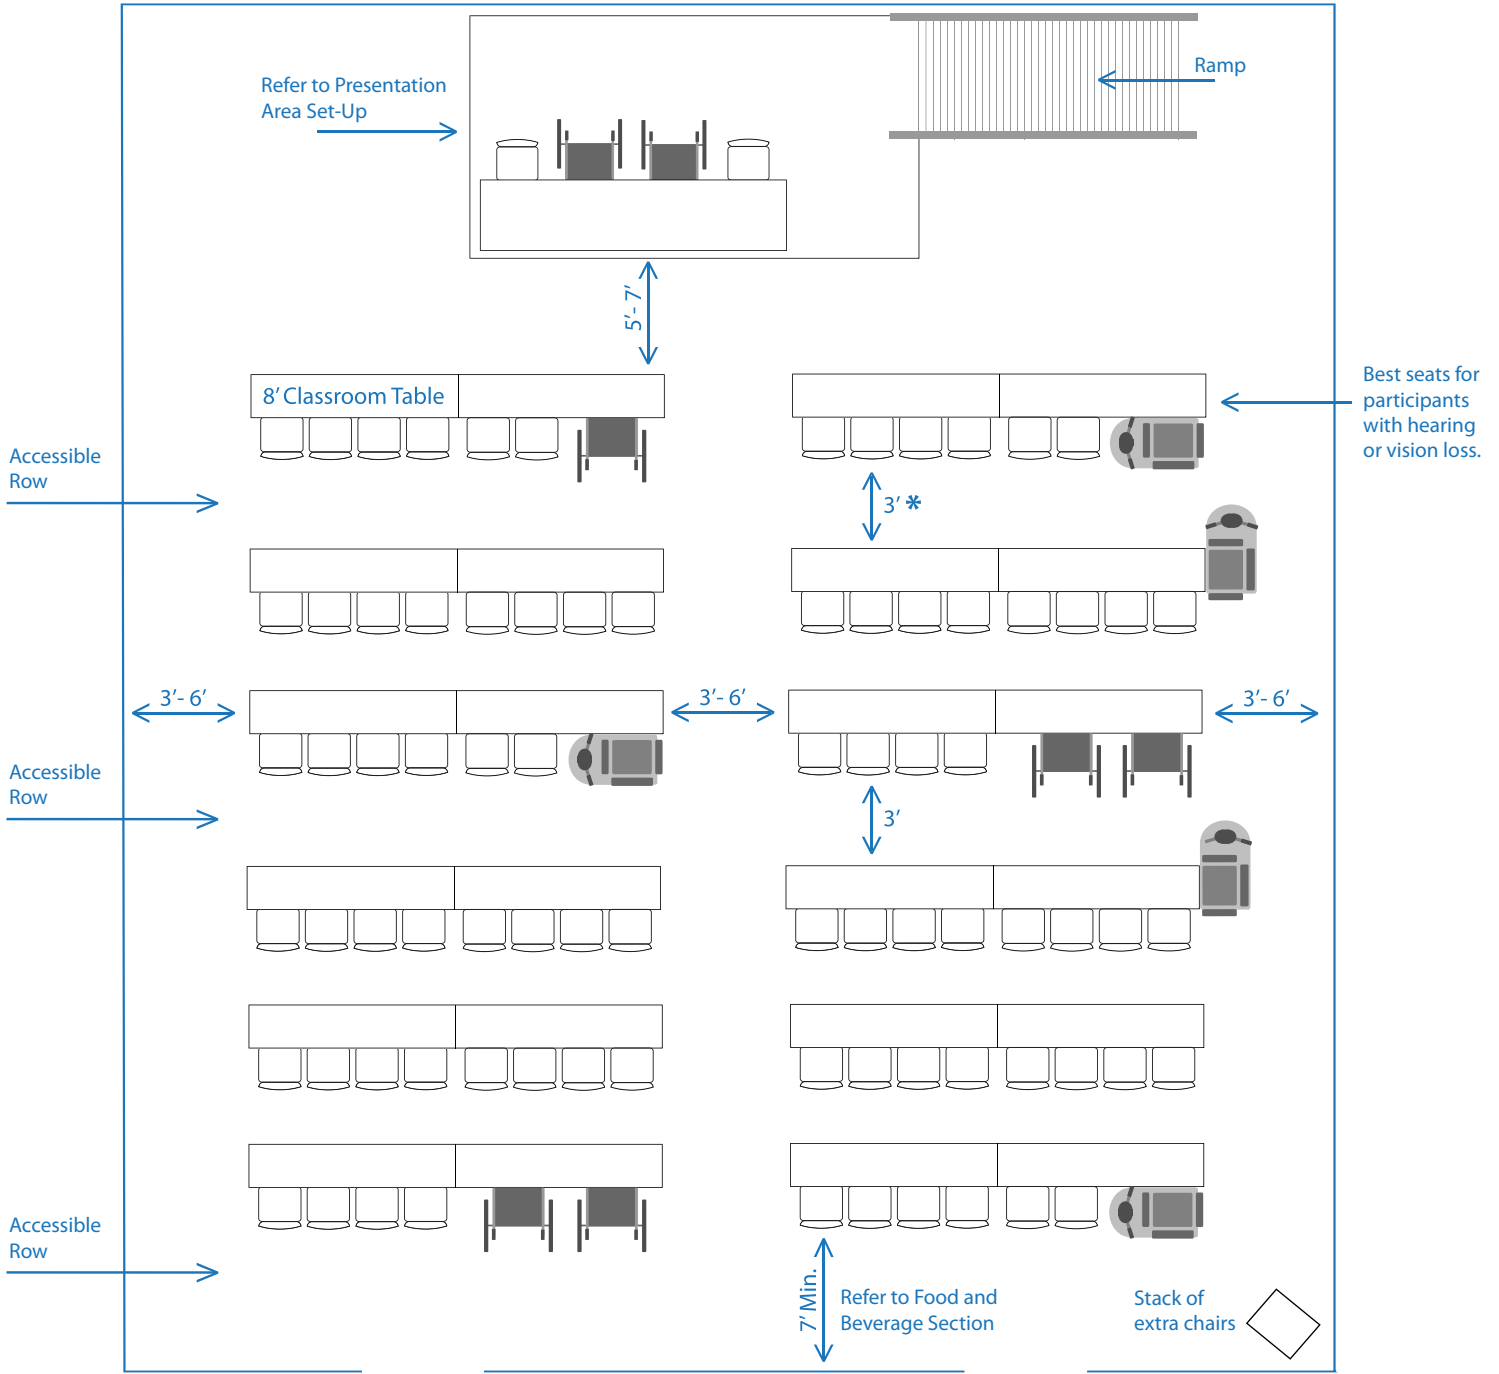

Doors should be propped open in advance of each session and again at the close. Stationing a person by the doors to help facilitate late entry or early exit is ideal.

* Measure from the back of the chair in the accessible row to the front edge of the table in the row behind the accessible row. This measurement is taken with chairs set with the front edge of the chair at the back edge of the table. In other words, the chairs should not be pushed under the tables.

